DRIVEWAY STANDARD DRAWING

TYPICAL PLAN VIEW

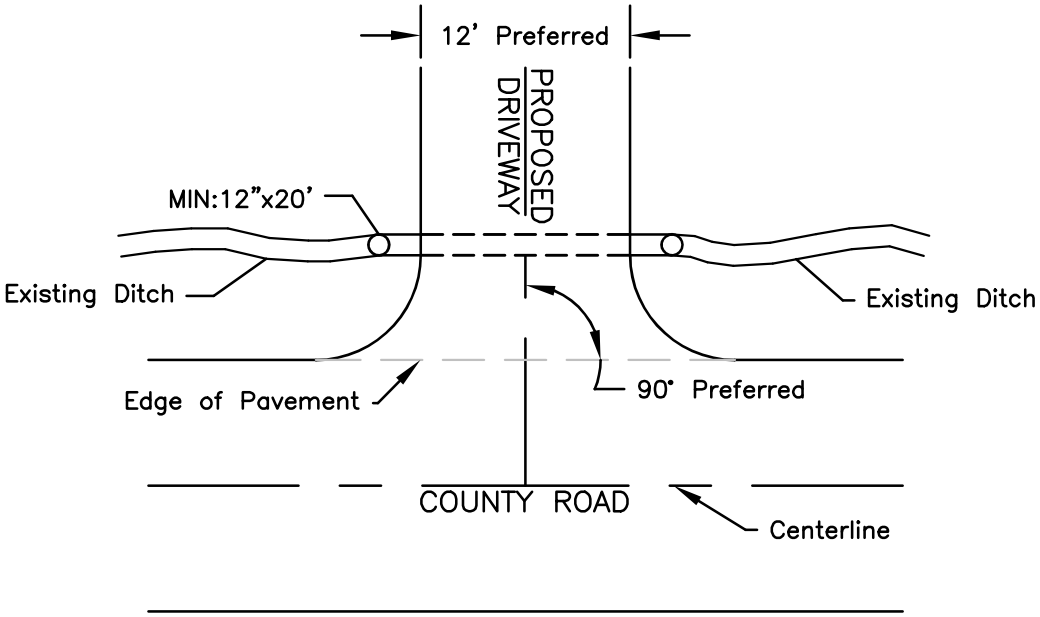

TYPICAL SECTION VIEW

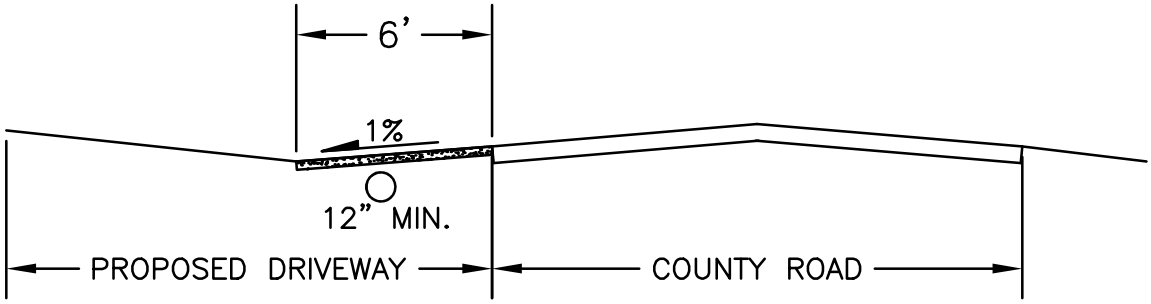

NOTES

1. Culvert pipe shall be smooth line PVC pipe.
2. Each new driveway location shall be approved by the County Engineer prior to installation.
3. The driveway must slope away from the edge of pavement. Water shall be diverted into the ditch line, and no water shall cross the roadway.
4. Culvert pipe shall be appropriately sized, and additional length may be required depending on vehicle size. The minimum culvert size in 12"x20' and shall be tied into the existing ditch line.
5. The County reserves the right to require any and all such measures, including uphill ditching, water diversion, or additional drainage structures as required to keep water, ice, mud and aggregate from running onto or accumulating on the roadway.

UNDERGROUND UTILITIES
CONTACT TWO WORKING DAYS
BEFORE YOU DIG

OHIO811.org
Before You Dig

Del George, P.E., P.S.
Harrison County Engineer